


**Errata to ASHRAE Pocket Guide for Air Conditioning, Heating, Ventilation, Refrigeration  
(SI Edition)**

**January 16, 2008**

**Page Errata**

**I-3** The graphs on these pages should be replaced with the single following graph, as data are missing for flow rates between 500 and 1000 L/s.

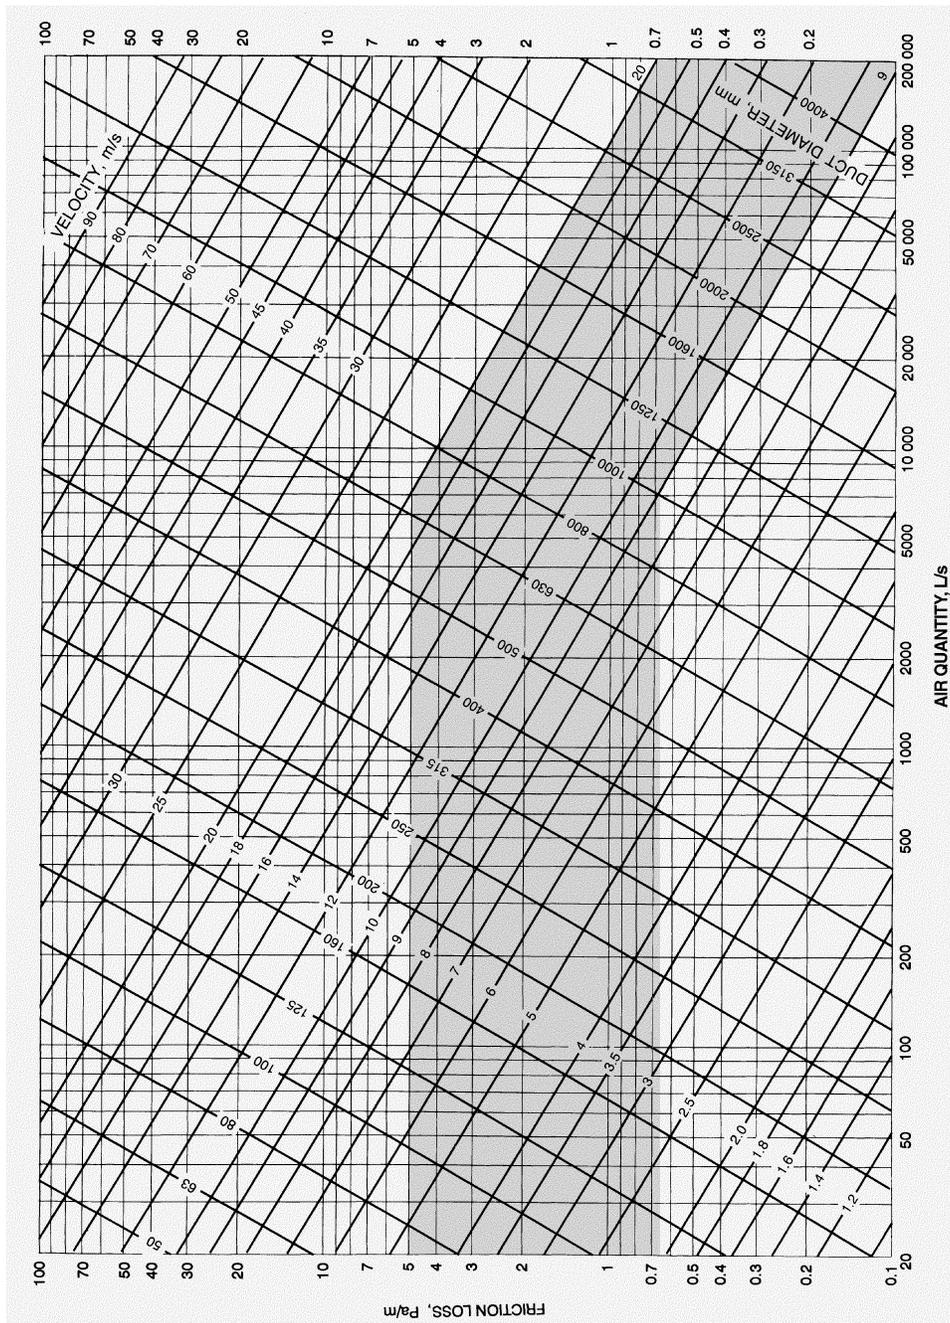

**Page****Errata****127**

Saturated suction temperatures are incorrect.

The headings currently read: -40 -5 0 20 40

They should read: -40 -30 -20 -5 5

**257**Density of water should be  $1000 \text{ kg/m}^3$  instead of  $100 \text{ kg/m}^3$ .