

**ERRATA SHEET FOR
ANSI/ASHRAE STANDARD 199-2016
Method of Testing the Performance of Industrial Pulse Cleaned Dust Collectors**

February 2, 2017

The corrections listed in this errata sheet apply to ANSI/ASHRAE Standard 199-2016. The first printing is identified on the outside back cover as “Product code: 86624 6/16”.

Page Erratum

- 7** **6.1 Test Dust.** Figure 6-1 was inadvertently omitted from the publication of Standard 199. Immediately following Bulk Density insert Figure 6-1 as shown below.

6.1 Test Dust. Test dust shall be fine ground calcium carbonate (wet ground marble) with the following typical properties:

CaCO₃: 95%

Hegman gauge: 6

Moisture: 0.12%


Plus 325 mesh: 0.003%

Particle size: 0.3 to 10 µm range, 3.0 µm median

Specific Gravity: 2.7

Bulk Density: 40lb/ft³ (641 kg/m³) loose, 65lb/ft³ (1041 kg/m³) packed

Figure 6-1: Typical particle size distribution (determined by Micromeritics SediGraph)

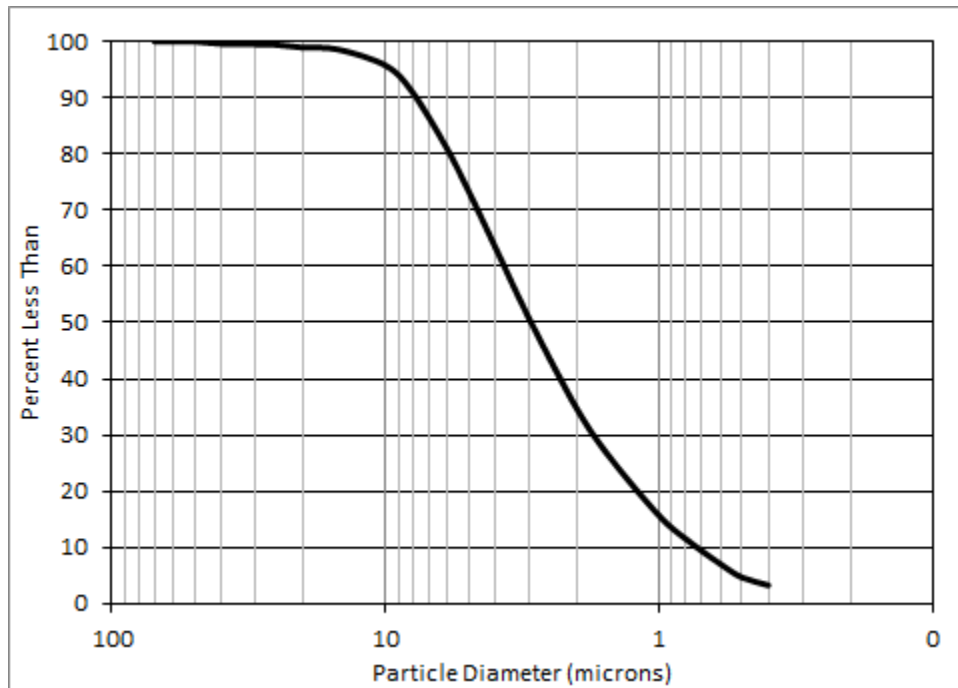

Test dust shall be stored in original unopened packaging in the conditions stated in Section 5.6.